



Order No.: Z210200262

PAVUS, a.s.

AUTHORIZED BODY AO 216
NOTIFIED BODY 1391
EGOLF MEMBER



FIRE TESTING LABORATORY VESELÍ NAD LUŽNICÍ

Testing Laboratory No. 1026 accredited by ČIA
Notified Testing Laboratory
Workplace Veselí nad Lužnicí

**REACTION TO FIRE
TESTS REPORT**

No. Pr-20-1.165-En

Issued on 2020-09-03

For product

Fire protection coating
FRED

Sponsor of the report: Intelligent Membranes Ltd
Clopton Farm
Lower Road
Croydon
SG 80EF
Cambridgeshire
United Kingdom

Sponsor of the tests: **Hevadex BV**
Spinnerslaan 6
9160 Lokeren
Belgium

Test method:

EN 13823+A1
» Reaction to fire tests for building products
– Building products excluding floorings exposed to the thermal
attack by a single burning item «

Report contains: 12 pages
(4 text pages + 3 annexes)

No. of copies: 2
Copy No.: 1

The report may not be reproduced other than in full, except with the written approval of testing laboratory.

Prosecká 412 / 74, 190 00 Prague 9 - Prosek, Czech Republic, mail to: mail@pavus.cz, [http:// www.pavus.cz](http://www.pavus.cz)
CIN: 60193174, TIN: CZ60193174, in Commercial Register of the Municipal Court in Prague, section B, inset 2309
Phone: +420 286 019 587

Branch Veselí nad Lužnicí

Čtvrť J. Hybeše 879, 391 81 Veselí nad Lužnicí, Czech Republic, mail to: veseli@pavus.cz
Phone: +420 381 477 418

1 INTRODUCTION

Reaction to fire tests of the product FRED had been performed in Fire Testing Laboratory of PAVUS, a.s. Veselí nad Lužnicí following the order of the company Hevadex BV (order No. Z210200070). The product name was FLAME-EX. The FLAME-EX is identical with the product distributed under private name FRED (declared by statement from Hevadex BV and Intelligent Membranes Ltd).

The tests were prepared, performed and evaluated on the basis of following documents:

- [1] EN 13823:2010+A1:2014 Reaction to fire tests for building products – Building products excluding floorings exposed to the thermal attack by a single burning item
- [2] EN 13238:2010 Reaction to fire tests for building products – Conditioning procedures and general rules for selection of substrates
- [3] Information provided by the sponsor

For the purposes of this report the definitions stated in [1] and [2] are valid together with following abbreviations:

ČIA Český institut pro akreditaci, o.p.s. (*Czech Institute for Accreditation, Public Service Company*)

ATL accredited testing laboratory

FTL fire technical laboratory

SBI generally used abbreviation for indication of test method derived from English name of the standard – see [1]

TC thermocouple

2 TESTS SUBJECT

According to [3]:	Product name:	FRED
	Product identification:	reactive coating for fire protection
	Producer:	Hevadex BV Spinnerslaan 6 9160 Lokeren Belgium
	Coating composition:	waterbased intumescent coating
	Colour:	white
	Coating density:	(1,35 ± 0,1) kg/l
	Solids:	(70 ± 2) %
	Delivered samples:	Batchnumber: 100 320 Mass of wet layer: 580 g/m ² Thickness of wet layer: ca. 420 µm Thickness of dry layer: 220 µm Substrate boards: PROMATECT H, thickness of 12 mm, density of 870 kg/m ³ , producer PROMAT International

Date of sample arrival: 2020-04-03

Sampling procedure and samples production: sponsor without participation of the ATL

Parameters of specimens:

Parameter	Nominal value	Measured values of specimen No.:				
		1	2	3	4	5
Specimen thickness (mm)	Not mentioned	ca 12.4	ca 12.3	ca 12.4	-	-
Specimen density (kg/m ³)	Not mentioned	ca 946	ca 934	ca 956	-	-
Specimen mass per unit area (kg/m ²)	Not mentioned	ca 11.7	ca 11.5	ca 11.9	-	-

Composition of samples:

- joints in wings: no
- cavities: none
- edges of wings: without modifications
- substrate: calcium silicate board thickness of 12 mm, density of 870 kg/m³, reaction to fire class A1

Conditioning: according to [2]

3 TESTS PERFORMANCE

Workplace of testing: FTL, room V215
 Test method: EN 13823:2010+A1:2014
 Deviations from the test method: no
 Used testing and measuring equipment: see Annex A
 Using of the video camera: no
 Presence of representatives during the test: no
 Ambient conditions:

Parameter	Test No.				
	1	2	3	4	5
Date of test	2020-04-15	2020-05-07	2020-05-07	-	-
Ambient pressure (Pa)	97,450	97,240	97,190	-	-
Ambient humidity (%)	26	23	24	-	-

Temperatures in exhaust duct and ambient temperature before launching of the tests complied with requirements [1] cl. 8.2.2

Test procedure: according to [1] cl. 8
 Recording of measured value: according to [1] cl. 8.4, data file format according to [1] Annex F
 Graphic expression of results: according to [1] cl. 9.1 and 9.2
 Graphs are stated in Annex B

4 TESTS RESULTS

4.1 Calculation results

Calculations of under-mentioned parameters were based on calculation procedures stated in [1] Annex A.

Parameter	Test No.				
	1	2	3	4	5
<i>FIGRA</i> _{0.2MJ} (W/s)	0.0	0.0	0.0	-	-
<i>FIGRA</i> _{0.4MJ} (W/s)	0.0	0.0	0.0	-	-
<i>THR</i> _{600s} (MJ)	0.5	0.4	0.5	-	-
<i>SMOGRA</i> (m ² /s ²) ¹⁾	0.0	0.0	0.0	-	-
<i>TSP</i> _{600s} (m ²) ¹⁾	43.5	34.4	33,5	-	-

¹⁾ Smoke calculation: alternative

4.2 Recorded events

Visual observation was realised according to [1] cl. 8.3 and it is summed up in following table.

Parameter	Test No.				
	1	2	3	4	5
Lateral flame spread on the long wing according to [1] cl. 8.3.3	no	no	no	-	-
Flaming particles or droplets according to [1] cl. 8.3.4	no	no	no	-	-
a) that remains flaming for not more than 10 s after falling	no	no	no	-	-
b) that remains flaming for more than 10 s after falling	no	no	no	-	-
Surface flash according to [1] cl. 8.3.6 a)	no	no	no	-	-
Smoke not entering the hood according to [1] cl. 8.3.6 b)	no	no	no	-	-
Falling of parts of the specimen according to [1] cl. 8.3.6 c)	no	no	no	-	-
Development of a gap in the corner (failure of mutual fixing of backing boards) according to [1] cl. 8.3.6 d)	no	no	no	-	-
Occurrence of one or more of the conditions which justify an early termination of the test according to [1] cl. 8.5 – see [1] cl. 8.3.6 e)	no	no	no	-	-
Occurrence of distortion or collapse of the specimen according to [1] cl. 8.3.6 f)	no	no	no	-	-
Additional events that may be of importance to the correct interpretation of the test results or to the field of application of the product according to [1] cl. 8.3.6 g)	no	no	no	-	-

Photos according to [1] cl. 5.3.3 are displayed in Annex C.

4.3 Application of test results

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire hazard of the product in use.

Report and annexes sheets
are valid with embossed stamp only.

Elaborated by:
Ladislav MĚSTKA
ATL Engineer

Approved by:
Jiří KÁPL
ATL Manager

This copy has been produced from a PDF format file that has been provided by PAVUS Fire Testing Laboratory to the sponsor of the document and must only be reproduced in full. Extract or abridgements of the document must not be published without permission of PAVUS Fire Testing Laboratory. The original signed paper versions of this document are the sole authentic versions. Only original paper versions of this document bear authentic signatures of the responsible PAVUS staff.

ANNEX A: TESTING AND MEASURING EQUIPMENT, MEASUREMENT UNCERTAINTY

Test apparatus	Registration number
Test room and fixed frame	0036
Burner switch, gas distribution and flame detectors	0037
Trolleys and removable panel parts	0038
Data acquisition system (PC)	0039
Hood, collector and exhaust duct	0040
Light attenuation system, of the white light type	0041
Sandbox burners, shield of auxiliary burner	0042
Propane reservoir + propane of minimum purity 95 %	0043
PLC	0045
Ventilator with flow regulation	0046
Bi-directional probe, duct	0047
Gas sampling probe, filter and duct	0048
Ventilator	0116
Conditioning air chamber PO 1	0057

Measuring equipment	Metrological registration number
TC (K), diameter 0.5 mm – gas temperature in duct	3 10 28
TC (K), diameter 2 mm – ambient temperature	3 10 55
Pressure difference transducer (from bi-directional probe)	3 09 25
O ₂ analyser	3 16 04
CO ₂ analyser	3 16 05
Mass flow controller F112 AC-FAC	3 08 18
Thermo-hygro-baro-graph D4130	3 13 08, 3 09 11
Stop-watches GEONAUITE	3 05 11
Balance Sartorius 60 kg	3 04 07
Slide calliper 150 mm	3 01 07
Tape measure – 5 m	3 01 05

The metrological relationships of the device are defined in the metrological registration card of the device; this card is expressly identified by the metrological registration number of the device.

Measured quantity			Expanded measurement uncertainty
Name	Symbol	Unit	
Time from start of the test	t	min	3.4×10^{-2}
Mass flow of propane	m_{gas}	mg/s	3.5
Pressure difference from the bi-directional probe	Δp	Pa	3
Relative light intensity	I	%	0.57 relative, < 5 absolute
O ₂ concentration	x_{O_2}	% Vol.	0.01
CO ₂ concentration	x_{CO_2}	% Vol.	0.01
Temperature of air flowing under the trolley	T	°C	2
Temperature of gas in duct (general measurement section)	T_{ms}	°C	$\sqrt{(6.40 \times 10^{-6} T^2 + 1.57 \times 10^{-1} T^2)}$, for $40^\circ\text{C} \leq T < 375^\circ\text{C}$

Uncertainty HRR and SPR depends only on measuring and testing equipments and on level of the parameter. The upper estimations of the relative uncertainties derived from the parameters HRR and SPR were determined from maximal possible values of the measurement uncertainties of individual directly measured values (allowed by the test standard):

$$U_{HRR} < 85.0 \cdot HRR^{0.841} \quad (\%)$$

$$U_{SPR} < 5.32 \cdot SPR^{0.639} \quad (\%)$$

Uncertainties of other derived parameters depend also on behaviour of the testing sample and may be determined acc. to ISO/TS 2148: 5.3.2, which is realised by Fire Testing Laboratory only upon request of the.


The reported expanded uncertainties of measurement are stated as the standard uncertainties of measurement multiplied by the coverage factor $k = 2$, which for a normal distribution corresponds to a coverage probability of approximately 95 %.

The standard uncertainty of measurement has been determined in accordance with EA-4/16 and GUM.

ANNEX B: MEASUREMENT

Graphic expression of results

Test No. 1

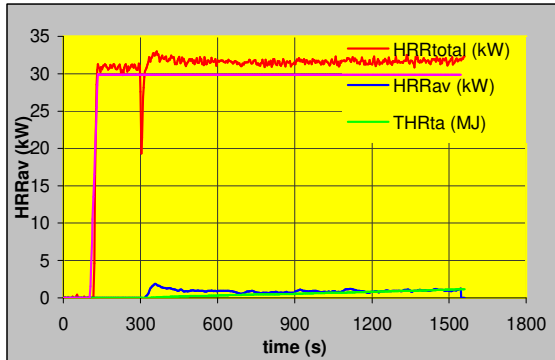

Date of test: 15th April 2020
 File name: Z210200070a.sb1
 Operator: Městka

Specifications

Material: FLAME-EX TYPE 1
 Mass per unit area (kg/m²): 11.735
 Thickness (mm): 12.4

Fire attack


Start of test (s): 300
 Burner exposure time (s): 1440
 Burner exposure level (kW): 30.743

Test conditions

Mounting: Sponsor
 Substrate: calcium silicate board
 Fixing: paint
 Standard used: EN 13823+A1

Results


Heat release related	t-t0 (s)	t(s)
Peak HRRav (t<t0+600s) [kW]:	1.8	357
Peak HRRav (t<t0+900s) [kW]:	1.8	357
Peak HRRav (t<t0+1200s) [kW]:	1.8	357
Peak HRRav (t>t0) [kW]:	1.8	357

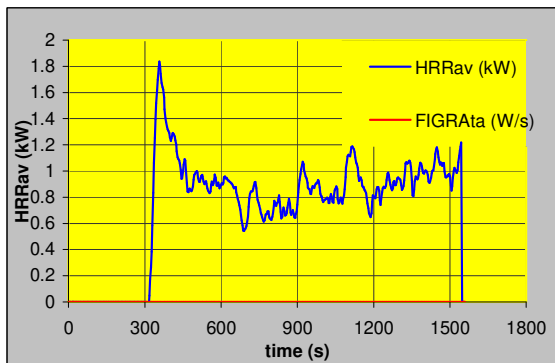

THRta (t0_t0+600s) [MJ]:	0.5	B or better
THRta (t0_t0+900s) [MJ]:	0.8	
THRta (t0_t0+1200s) [MJ]:	1.1	

Figra_treshold1 [W/s]:	0.00	
Figra_treshold2 [W/s]:	0.00	
Figra [W/s]:	0.00	B or better
Corresponding HRRav [kW]:	0.00	-300 0
t(HRRav >= 3[kW]):	9699	9999
t(THRta >= 0.2[MJ]):	189	489
t(THRta >= 0.4[MJ]):	423	723

Estimated class: B or better

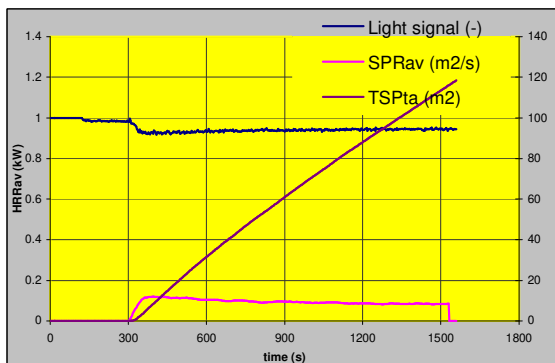


Smoke production related	t-t0 (s)	t(s)
Peak SPRav (t<t0+600s) [m ² /s]:	0.12	96
Peak SPRav (t<t0+900s) [m ² /s]:	0.12	96
Peak SPRav (t<t0+1200s) [m ² /s]:	0.12	96
Peak SPRav (t>t0) [m ² /s]:	0.1	96


TSPta (t0_t0+600s) [m²]:	60.9	S2
TSPta (t0_t0+900s) [m ²]:	88.0	
TSPta (t0_t0+1200s) [m ²]:	113.4	

Smogra max [m²/s²]:	15.17	S1
at SPRav [m ² /s]:	0.10	78
t(SPRav >= 0.1[m ² /s]):	51	351
t(TSPta >= 6[m ²]):	78	378

Estimated class: S2

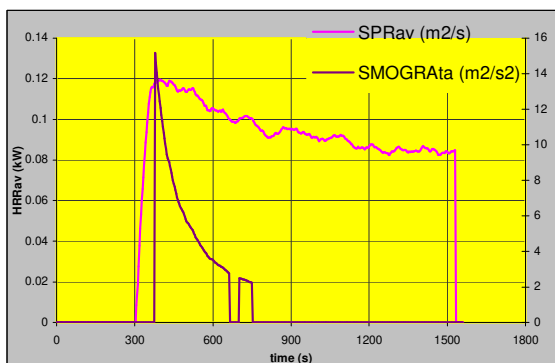

Test No. 2

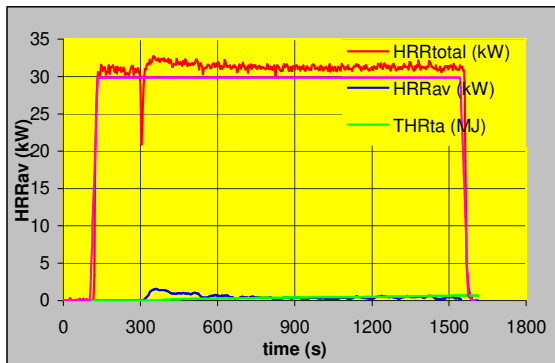


Date of test: 7th May 2020
 File name: Z210200070a.sb2
 Operator: Městka

Specifications

Material: FLAME-EX TYPE 1
 Mass per unit area (kg/m²): 11.486
 Thickness (mm): 12.3

Fire attack

Start of test (s): 300
 Burner exposure time (s): 1440
 Burner exposure level (kW): 30.845

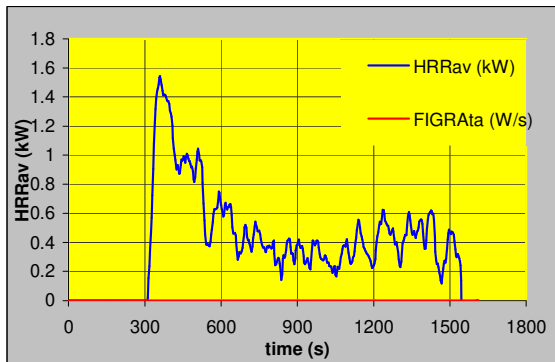
Test conditions

Mounting: Sponsor
 Substrate: calcium silicate board
 Fixing: paint
 Standard used: EN 13823+A1

Results

Heat release related	t-t0 (s)	t(s)
Peak HRRav (t<t0+600s) [kW]:	1.5	60
Peak HRRav (t<t0+900s) [kW]:	1.5	60
Peak HRRav (t<t0+1200s) [kW]:	1.5	60
Peak HRRav (t>t0) [kW]:	1.5	60

THRta (t0_t0+600s) [MJ]: 0.4 B or better

THRta (t0_t0+900s) [MJ]: 0.5

THRta (t0_t0+1200s) [MJ]: 0.6

Figra_treshold1 [W/s]: 0.00

Figra_treshold2 [W/s]: 0.00

Figra [W/s]: 0.00 B or better


Corresponding HRRav [kW]: 0.00 -300 0

t(HRRav >= 3[kW]): 9699 9999

t(THRta >= 0.2[MJ]): 198 498

t(THRta >= 0.4[MJ]): 603 903

Estimated class: B or better

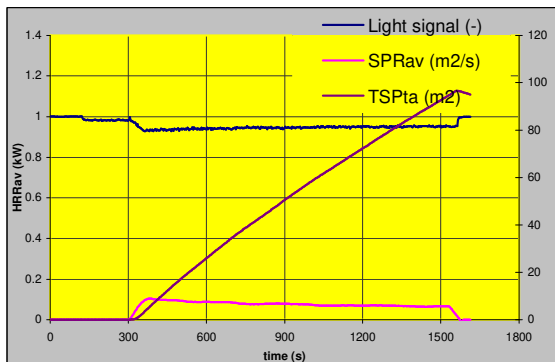
Smoke production related

Peak SPRav (t<t0+600s) [m²/s]: 0.10 84 384

Peak SPRav (t<t0+900s) [m²/s]: 0.10 84 384

Peak SPRav (t<t0+1200s) [m²/s]: 0.10 84 384

Peak SPRav (t>t0) [m²/s]: 0.1 84 384

TSPta (t0_t0+600s) [m²]: 50.5 S2

TSPta (t0_t0+900s) [MJ]: 72.3

TSPta (t0_t0+1200s) [MJ]: 92.7


Smogra max [m²/s²]: 11.47 S1

at SPRav [m²/s]: 0.10 90 390


t(SPRav >= 0.1[m²/s]): 69 369

t(TSPta >= 6[m²]): 90 390

Estimated class: S2

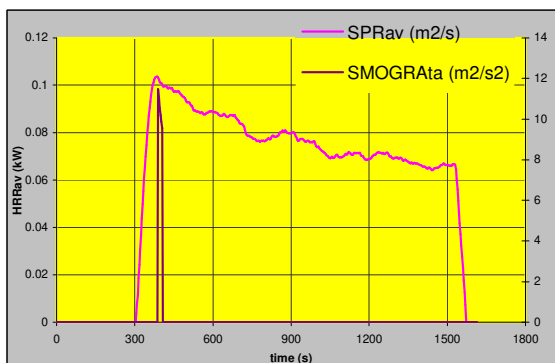

Test No. 3

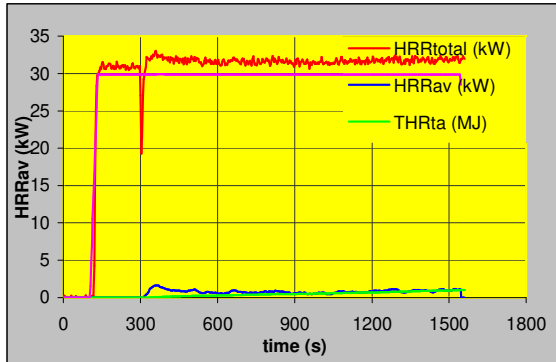


Date of test: 7th May 2020
 File name: Z210200070a.sb3
 Operator: Městka

Specifications

Material: FLAME-EX TYPE 1
 Mass per unit area (kg/m²): 11.852
 Thickness (mm): 12.4

Fire attack

Start of test (s): 300
 Burner exposure time (s): 1440
 Burner exposure level (kW): 30.896

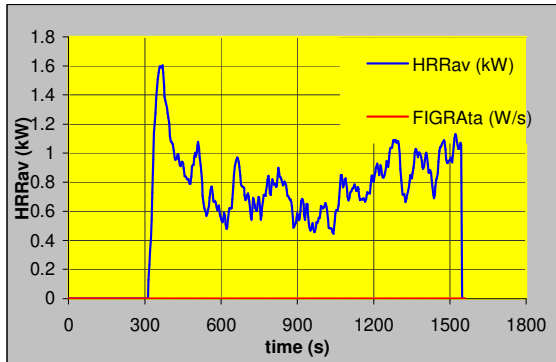

Test conditions

Mounting: Sponsor
 Substrate: calcium silicate board
 Fixing: paint
 Standard used: EN 13823+A1


Results

Heat release related	t-t0 (s)	t(s)	
Peak HRRav (t<t0+600s) [kW]:	1.6	69	369
Peak HRRav (t<t0+900s) [kW]:	1.6	69	369
Peak HRRav (t<t0+1200s) [kW]:	1.6	69	369
Peak HRRav (t>t0) [kW]:	1.6	69	369

THRta (t0_t0+600s) [MJ]:	0.5	B or better
THRta (t0_t0+900s) [MJ]:	0.7	
THRta (t0_t0+1200s) [MJ]:	1.0	

Figra_treshold1 [W/s]:	0.00		
Figra_treshold2 [W/s]:	0.00		
Figra [W/s]:	0.00	B or better	
Corresponding HRRav [kW]:	0.00	-300	0
t(HRRav >= 3[kW]):		9699	9999
t(THRta >= 0.2[MJ]):		201	501
t(THRta >= 0.4[MJ]):		486	786

Estimated class: B or better

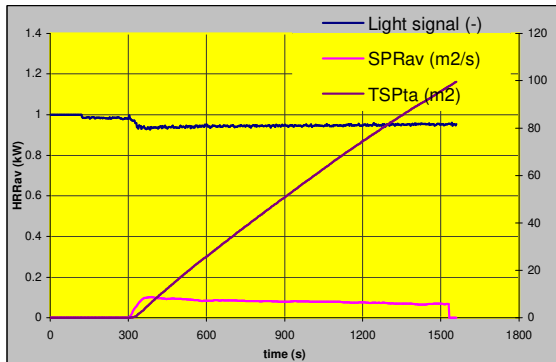

Smoke production related


	t-t0 (s)	t(s)	
Peak SPRav (t<t0+600s) [m ² /s]:	0.10	90	390
Peak SPRav (t<t0+900s) [m ² /s]:	0.10	90	390
Peak SPRav (t<t0+1200s) [m ² /s]:	0.10	90	390
Peak SPRav (t>t0) [m ² /s]:	0.1	90	390

TSPta (t0_t0+600s) [m²]:	50.8	S2
TSPta (t0_t0+900s) [m ²]:	74.5	
TSPta (t0_t0+1200s) [m ²]:	95.5	

Smogra max [m²/s²]: 12.05 S1

at SPRav [m ² /s]:	0.10	84	384
t(SPRav >= 0.1[m ² /s]):		75	375
t(TSPta >= 6[m ²]):		84	384

Estimated class: S2

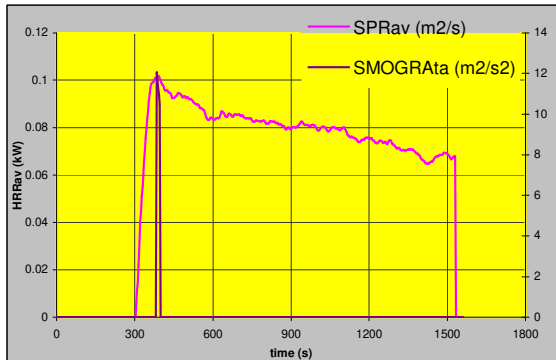

For purposes of the annex the terms, definitions and indication of the parameters stated in EN 13823+A1 and EN 13501-1 were used together with the following ones:

HRR_{total}	Total heat release rate of the specimen and burner (kW) – see [1] cl. A.5.1.1 d) formula (A.12)
HRR_{av}	Average heat release rate of the specimen (kW) – see [1] cl. A.5.3 a)
$q_{gas, 30s}$	Average theoretical heat release rate corresponding to the propane mass flow (kW) – see [1] cl. A.7
THR	Total heat release of the specimen during the period $300\text{ s} \leq t \leq t_a$ (MJ) – see [1] cl. A.5.2 formula (A.21)
THR_{600s}	Total heat release of the specimen in the first 600 s of exposure to the main burner flames (MJ) – see [1] cl. 3.4 and A.5.2 formula (A.22)
$1000 \times HRR_{av}/(t-300)$	Auxiliary function for determination of parameters FIGRA (W/s) – see [1] cl. 9.1 and A.5.3 b) formula (A.24)
$FIGRA_{0,2MJ}$	Maximum of the quotient of heat release rate from the specimen and the time of its occurrence using a THR threshold of 0.2 MJ (W/s) – see [1] cl. 3.7 and A.5.3 b)
$FIGRA_{0,4MJ}$	Maximum of the quotient of heat release rate from the specimen and the time of its occurrence using a THR threshold of 0.4 MJ (W/s) – see [1] cl. 3.8 and A.5.3 b)
$FIGRA$	parameter $FIGRA_{0,2MJ}$ (W/s) for classes of reaction to fire A2 and B or parameter $FIGRA_{0,4MJ}$ (W/s) for class of reaction to fire C and D – see EN 13501-1 cl. 3.1.37
$I/100$	Signal from the light receiver (dimensionless, positive real number ≤ 1) – see [1] cl. A.6.1.1 b)
SPR_{av}	Average smoke growth rate index from the specimen (m^2/s) – see [1] cl. A.6.3 a)
TSP	Total smoke production of the specimen within $300\text{ s} \leq t \leq t_a$ (m^2) – see [1] cl. A.6.2 formula (A.34)
TSP_{600s}	Total smoke production from the specimen in the first 600 s of exposure to the main burner flames (m^2) – see [1] cl. 3.6 and A.6.2 formula (A.35)
$10000 \times SPR_{av}/(t-300)$	Auxiliary function for determination of parameters $SMOGRA$ (m^2/s^2) – see [1] cl. 9.2 and A.6.3 b) formula (A.37)
$SMOGRA$	Smoke growth rate; the maximum of the quotient of smoke production rate from the specimen and the time of its occurrence – see [1] cl. 3.9 and A.6.3 b) formula (A.37)

The above-stated expected classification classes of reaction to fire provided automatically by the used software are not subject of accredited activities of ATL. The mentioned values of the parameters of the smoke are calculated classically.

ANNEX C: PHOTOGRAPHIC DOCUMENTATION

After installation of the specimen to the trolley the photos were taken according to [1] cl. 5.3.3.



Specimen No. 1




Specimen No. 2



Specimen No. 3


Total views of the exposed surfaces of the long wings

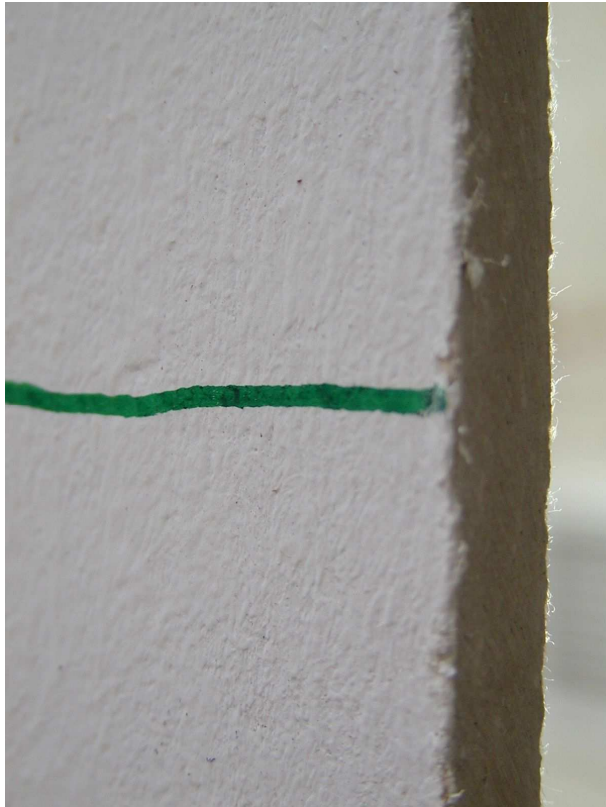

Specimen No. 1



Specimen No. 2

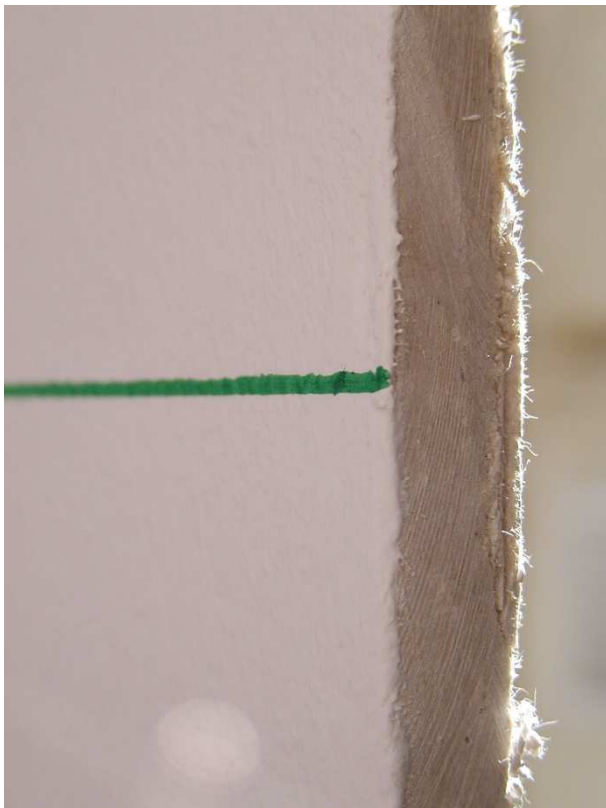

Specimen No. 3


Close-up of the vertical outer edges of the long wings at a height of 500 mm above the floor of the trolley



Specimen No. 1



Specimen No. 2

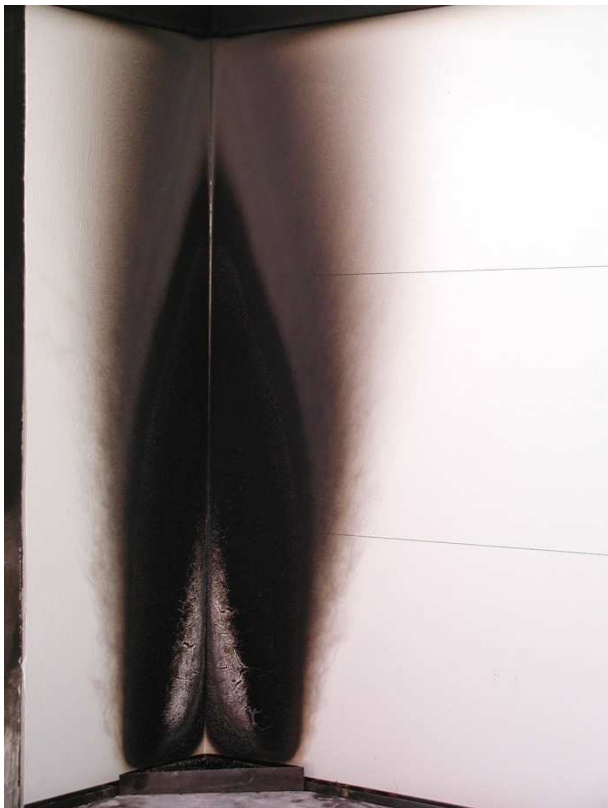

Specimen No. 3

Views to the specimens after tests